

INSTALLATION INSTRUCTIONS FOR PHOTOLUMINESCENT EXIT SIGNS LISTED TO UL924



RATED VIEWING DISTANCE IS 75 FEET

You have purchased an EverGlow® brand EXIT Sign manufactured to the highest quality standards. This sign has been certified by Underwriters Laboratories to comply with the UL 924 performance standard. This EverGlow® EXIT Sign contains no toxic, radioactive or flammable materials. Our sign is made with safety grade photoluminescent pigments, durable one-piece aluminum construction and supplied with two directional chevrons and stainless steel fasteners. It will provide an infinite number of recharge-glow cycles and the special protective coating will resist moisture.

CAUTION: EXTERNAL ILLUMINATION SOURCE REQUIRED

Install only in a location where a minimum of 5 foot candles (54 lux) of LED, Fluorescent, Metal Halide or Mercury Vapor lighting is available on the face of the sign at all times of building occupancy.

The external lighting source must be deemed reliable and supplied by a circuit not controlled by automatic timers or sensors that turn off the charging light when the building is occupied, and whose controls are accessible only to authorized personnel.

MAINTENANCE

Lighting levels on the sign are to be reassessed after any changes in external lighting types or levels to determine that this sign is still being illuminated in accordance to its listing.

The sign face should be kept clean with a periodic wipe with a damp cloth.

Perform periodic visibility tests in accordance with local code requirements.

INSTALLATION

Use stainless steel or corrosion resistant mechanical fasteners to affix the sign to the building.

Install indoors only in a location where not exposed to direct sunlight, liquid spray or temperatures outside the range of 50° -104° F (10° - 40° C).

DIRECTIONAL INDICATORS

Two chevrons are included for use as needed and should only be affixed in the similarly marked area(s) on the sign face. Do not use two chevrons to indicate the same direction. **Apply the chevrons without touching the adhesive.**

SAVE THESE INSTRUCTIONS FOR FIRE SAFETY INSPECTIONS




Toll Free: 866-744-4706
Tel: 704-841-2580 Fax: 704-841-2582
info@everglow.us
www.everglow.us

EverGlow® NA, Inc.
1122 Industrial Dr.
PO Box 830
Matthews, NC 28106-0830

ASSEMBLY INSTRUCTIONS

SIGN, ELP FRAME & MOUNTING BRACKET

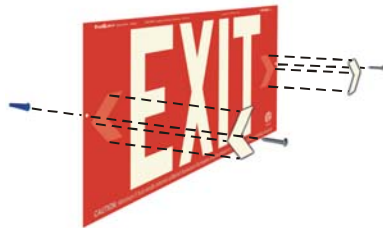


Sign Without a Frame mounts directly to the wall with stainless steel fasteners and wall anchors.

1. Using the predrilled holes, stainless steel fasteners (and wall anchors) fasten the sign to the wall or other mounting surface.
2. Fasten chevrons to the sign as necessary to indicate direction of nearest exit.


Single-Side Sign with an ELP Frame mounts directly to the wall with stainless steel fasteners and wall anchors.

1. Drill mounting holes into the wall; insert anchors. Install sign with stainless steel fasteners.
2. Use premium construction to supplement mechanical fasteners as desired.
3. Fasten chevrons to the sign face as necessary to indicate direction of nearest exit.

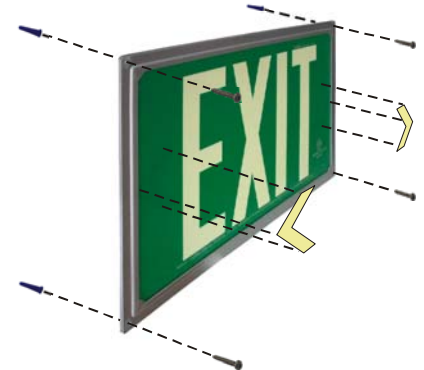

Single- and Double-Side Sign with an ELP Frame and Mounting Bracket are installed to the wall or the ceiling with stainless steel fasteners and wall anchors.

1. Following requirements of the Installation Instructions, determine the position of the sign on the wall or ceiling.
2. Center bracket on top or side of frame as desired, mark holes and drill frame.
3. Install mounting bracket to wall or ceiling as desired using stainless steel fasteners.
4. Insert the assembled frame and sign(s) into the mounting bracket and tighten fasteners as shown.
5. Install chevrons as necessary to indicate direction of nearest exit.

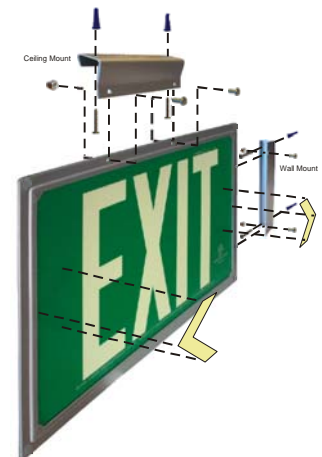

Parts List: (as supplied)

Aluminum Sign Face(s)
Directional Chevrons

Stainless Steel Fasteners
Plastic Wall Anchors

Aluminum Frame Aluminum Mounting Bracket
Nickel Plated Bolts & Acorn Nuts for Bracket

Toll Free: 866-744-4706
Tel: 704-841-2580 Fax: 704-841-2582
info@everglow.us
www.everglow.us

EverGlow® NA, Inc.
1122 Industrial Dr.
PO Box 830
Matthews, NC 28106-0830